


BOTTOM STRAP: MIN 1 1/2"  
WIDE X MIN 33 MIL ON TOP AND BOTTOM  
OF JOISTS. USE MIN (1) SCREW TO EACH  
FLANGE OF EACH JOIST.  
TOP STRAP MAY BE OMITTED IF STRUCTURE  
FLOOR SHEATHING IS USED OVER ENTIRE  
FLOOR SYSTEM.

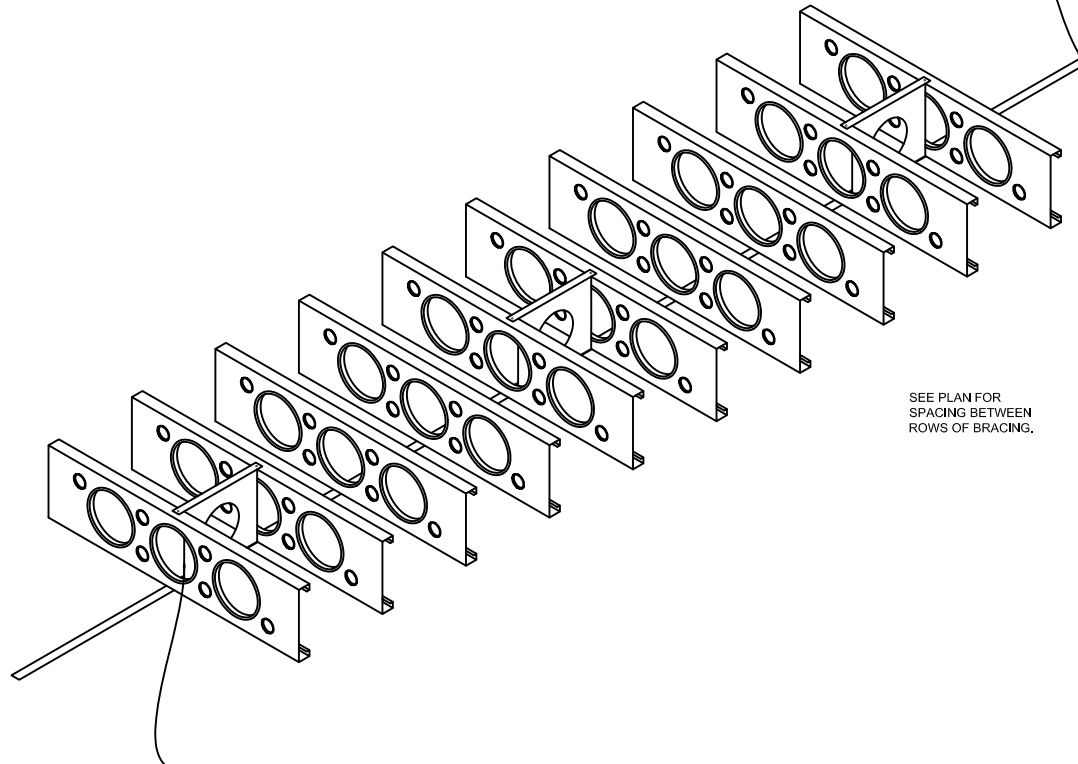

SEE PLAN FOR  
SPACING BETWEEN  
ROWS OF BRACING.

SOLID BLOCKING: AT EACH END OF STRAPS, AND MAXIMUM 10' O.C.  
ALONG STRAPS. ALL (4) TABS MUST BE DIRECTLY ATTACHED TO JOIST  
FLANGES USING MIN (1) SCREW. SCREWS THROUGH STRAPS MAY BE  
USED TO MEET THIS REQUIREMENT.

SEE SEPARATE DETAIL FOR STRAP SPLICE OPTIONS.

ALL SCREWS MIN #10 DIAMETER.

## JOIST BLOCKING: BOTTOM STRAPPING ONLY

