


TOP AND BOTTOM STRAPS: MIN 1 1/2"
WIDE X MIN 33 MIL ON TOP AND BOTTOM
OF JOISTS. USE MIN (1) SCREW TO EACH
FLANGE OF EACH JOIST.
TOP STRAP MAY BE OMITTED IF STRUCTURE
FLOOR SHEATHING IS USED OVER ENTIRE
FLOOR SYSTEM.

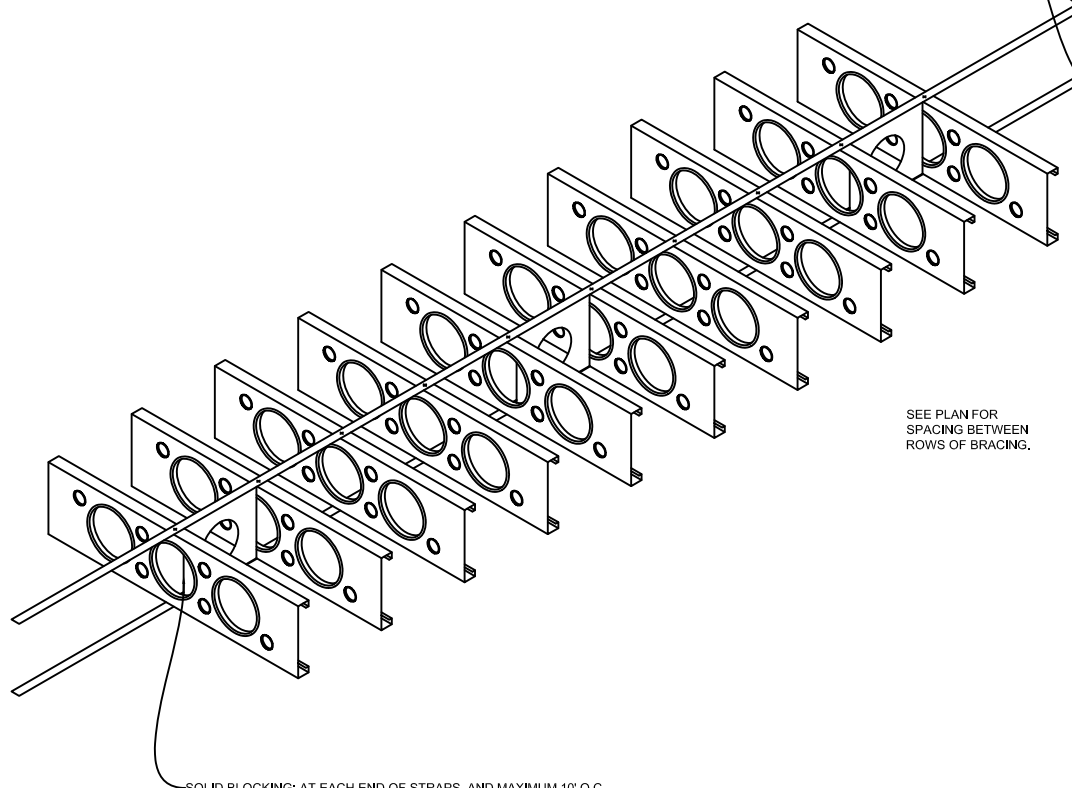

SEE PLAN FOR
SPACING BETWEEN
ROWS OF BRACING.

SOLID BLOCKING: AT EACH END OF STRAPS, AND MAXIMUM 10' O.C.
ALONG STRAPS. ALL (4) TABS MUST BE DIRECTLY ATTACHED TO JOIST
FLANGES USING MIN (1) SCREW. SCREWS THROUGH STRAPS MAY BE
USED TO MEET THIS REQUIREMENT.

SEE SEPARATE DETAIL FOR STRAP SPLICE OPTIONS.

ALL SCREWS MIN #10 DIAMETER.

JOIST BLOCKING: WITH TOP & BOTTOM STRAPPING